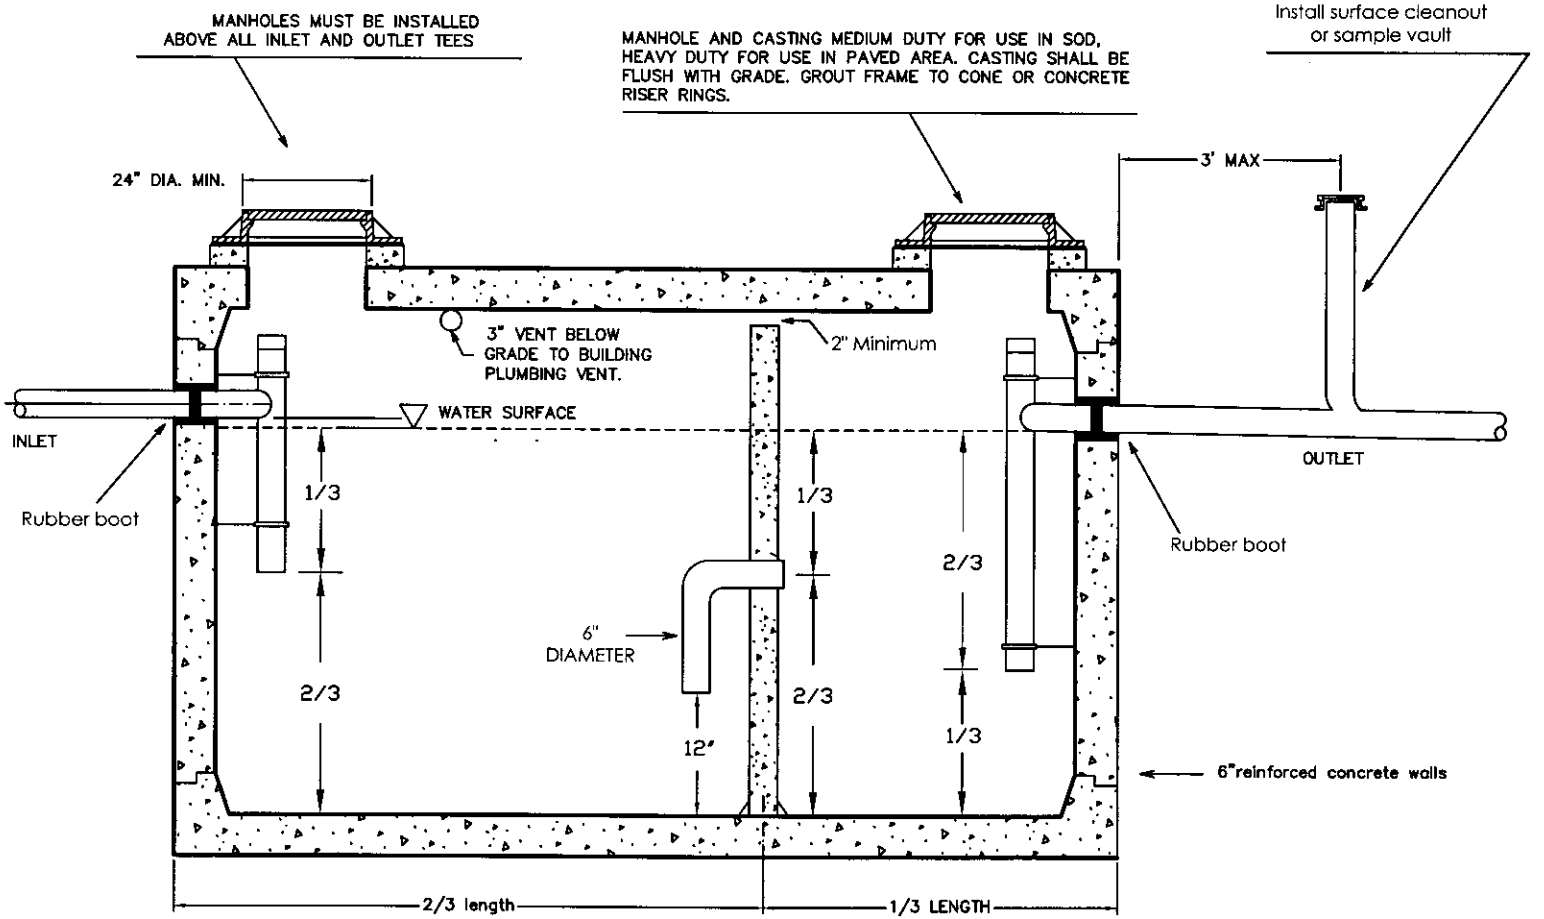

PIPES MINIMUM OF 4" DIAMETER PVC CONFORMING TO ASTM D- 3034 SDR-35.
GREASE INTERCEPTOR SHALL BE H-20 TRAFFIC RATED IF SET IN PAVED AREAS.
CASTINGS AND LIDS SHALL BE EJIW 1020 SERIES OR EQUIVALENT,NON BOLT DOWN AND LABELED "GREASE".
ALL EQUIPMENT AND COMPONENTS INSTALLED WITHIN THE GREASE INTERCEPTOR MUST BE MANUFACTURED FROM NON-CORROSIVE MATERIALS.

CITY OF BLOOMINGTON UTILITIES ENGINEERING
NO SCALE
08/07/06
T. AXSOM

STANDARD GREASE INTERCEPTOR

STANDARD DETAIL NUMBER 21