

# City of Bloomington Utilities

## Typical Standard for


# Water System Nomenclature

STANDARD METER PIT DIAMETERS:

SINGLE 1" YOKE- 24"

SINGLE 2" YOKE- 30"

MULTIPLE YOKES- DETERMINED CASE  
BY CASE

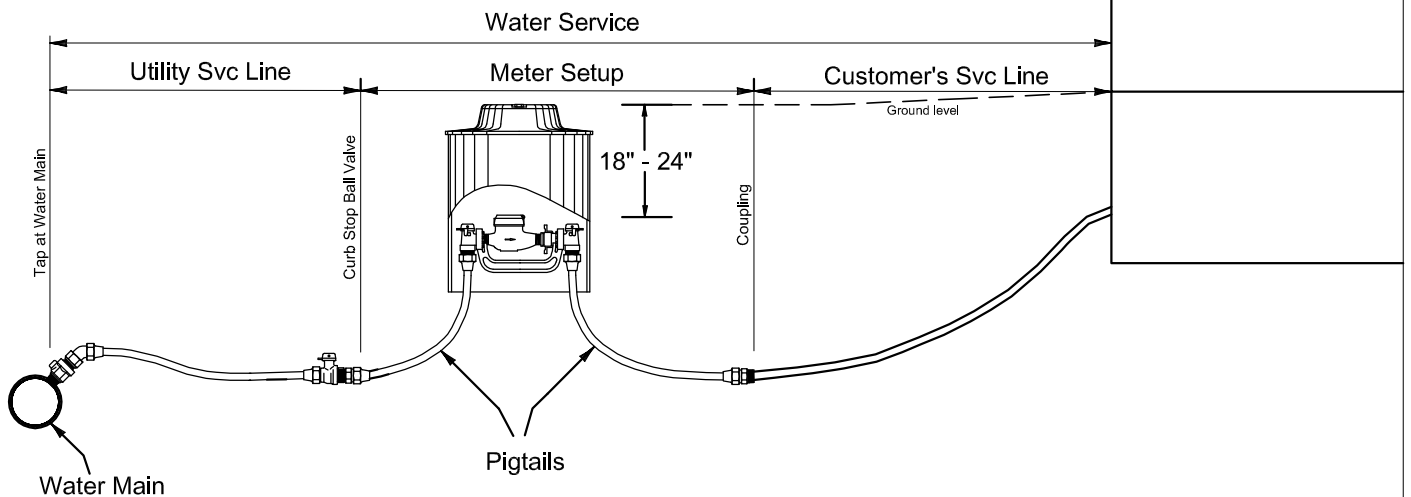

City of Bloomington Utilities Engineering Department

03/30/06  
N. Avsorn  
02/03/14  
G. Nettleton

Drawing File:

I:\Common\Standard Drawing\std10.dwg

**WATER SYSTEM NOMENCLATURE**

STANDARD  
DETAIL  
NUMBER **10**