

# STANDARD WATER METER PIT


## STANDARD METER PIT DIAMETERS:

SINGLE 1" YOKE- 24"

8C1 6@9 % "MC ? 9G ! 24"

SINGLE 2" YOKE- 30"

MULTIPLE YOKES - DETERMINED  
CASE BY CASE

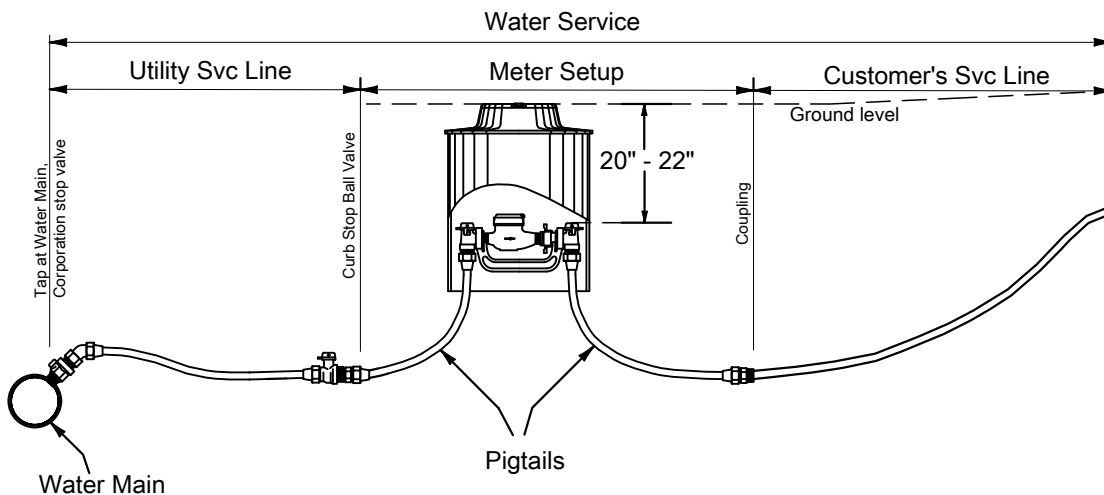

City of Bloomington Utilities Engineering Department

03/30/06  
N. Auzon  
02/03/14  
G. Nettleton

Drawing File:

I:\Common\Standard Drawing\std10.dwg

STANDARD METER PIT

STANDARD  
DETAIL  
NUMBER

10